Alarm siren (SystemPort) – MANUAL



ORDER-CODES:
KFLASH1

Overview

The Kentix alarm siren is used for acoustic and visual signaling in the event of an alarm. It is suitable for both indoor and outdoor installation (IP65 protection class).

The alarm siren is equipped with a 10 m long connection cable and is connected to the SystemPort of a suitable remote station via the supplied T-adapter. Suitable remote stations are SiteManager, AlarmManager and MultiSensor (Ethernet). The power supply is provided by the supplied power supply unit.

© Kentix GmbH. This file was automatically generated on 2026-11-11 06:08:15. Please visit docs.kentix.com for the latest documentation.


Safety instructions

Installation
Installation and commissioning may only be carried out by trained specialist personnel in accordance with the instructions.
No modifications of any kind may be made to Kentix GmbH products, with the exception of those described in the relevant instructions.
When installing Kentix devices, certain degrees of protection must be guaranteed.
Observe the relevant regulations for installations in the respective environment.
Only operate the products within the defined temperature range.
The instructions should be passed on to the user by the person carrying out the installation.
Kentix accepts no liability for damage to the devices or components caused by incorrect installation. Kentix accepts no liability for incorrectly programmed units.
Kentix accepts no liability for faults, material damage or other damage.
Use of the products, transport and storage
Protect the device from
moisture, dirt and damage during transportation, storage and operation.
Battery powered products
Do not use the products in potentially explosive atmospheres.
Only operate the products within the defined temperature range.
Installation and battery replacement may only be carried out by trained specialist personnel in accordance with the instructions.
Do not charge, short-circuit, open or heat batteries.
Observe the correct polarity when inserting the batteries.
The devices must always be operated with the batteries intended for the product.
When changing the batteries, always replace all batteries.
Dispose of old or used batteries properly.
Keep batteries out of the reach of children.
Maintenance
Kentix devices must be checked for functionality as part of annual maintenance.
Disposal
Electrical appliances and batteries must be disposed of separately from household waste.

Mounting and connection

The alarm siren is connected to the SystemPort of a suitable remote station. Suitable remote stations are SiteManager, AlarmManager and MultiSensor (Ethernet). The T-adapter is plugged in between the siren and the remote station. The third socket of the T-adapter is used to connect the power supply of the siren.

© Kentix GmbH. This file was automatically generated on 2026-11-11 06:08:15. Please visit docs.kentix.com for the latest documentation.

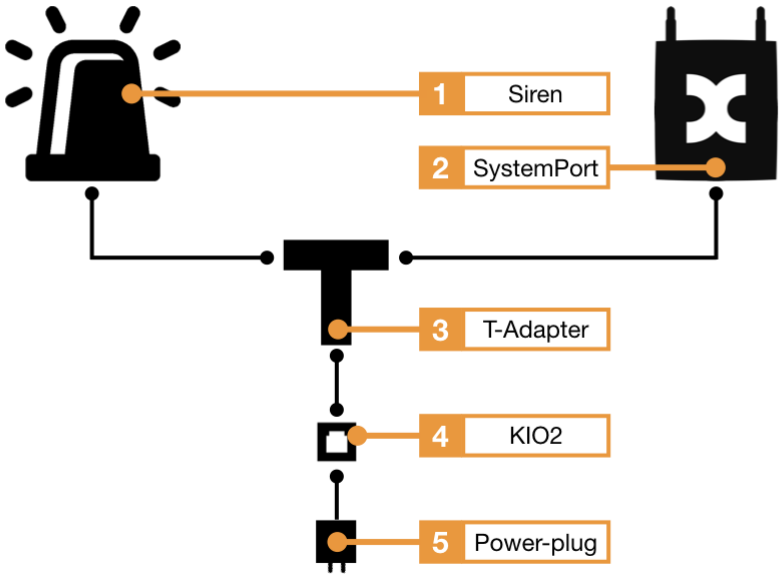

1. Alarm siren
2. Remote station with system port (TYPE-A)
3. T-adapter
4. Power adapter KIO2
5. Power supply 24VDC

ATTENTION! The siren must not be operated on devices (SmartPDU) with the Kentix TYPE-B system port.

Configuration with KentixONE

The device is configured via the web browser in KentixONE. The device must be accessible to the central KentixONE instance on the network side. Depending on the device type, a communication key and the IP address or DHCP name of the central KentixONE instance must also be set on the device (MultiSensors, AccessManager, SmartPDU). IP cameras or IO modules, on the other hand, can be integrated directly into KentixONE.

All information about the software can be found in the KentixONE section and the associated documentation.

Before starting the configuration, make sure that the software on all network-compatible Kentix devices is up-to-date. The version status must match on all devices.
You can perform a software update for your KentixONE main instance and all

© Kentix GmbH. This file was automatically generated on 2026-11-11 06:08:15. Please visit docs.kentix.com for the latest documentation.

connected satellites at any time via “System – Update”.

© Kentix GmbH. This file was automatically generated on 2026-11-11 06:08:15. Please visit docs.kentix.com for the latest documentation.