Wall reader (bus) DoorLock-WA3-V2 – MANUAL



ORDER-CODES:
KXC-WA3-IP1-V2, KXC-WA3-IP2-V2

DATA SHEET KXC-WA3-IPx-V2

Overview

Kentix IP wall readers enable contactless control of doors with a MIFARE® DESFire® RFID chip. The setup always consists of the actual wall reader and the connected Kentix AccessManager. The wall reader is connected to the AccessManager via a 4-wire connection. The AccessManager itself connects directly to a Power over Ethernet (PoE) capable network switch. To control electric strikes/motor locks, the SmartRelay offers two relay outputs and, depending on the power class of the strikes, an integrated PoE splitter with 24VDC output.

© Kentix GmbH. This file was automatically generated on 2026-11-04 05:47:31. Please visit docs.kentix.com for the latest documentation.

For the operation of the wall readers (version: V2), a Kentix AccessManager for cable readers (KXP-2-RS) with a KentixONE software version of 8.2.0 or higher is required. Information about the relay and **circuit diagrams including examples** can be found here: AccessManager (Bus)

Safety instructions

Installation
Installation and commissioning may only be carried out by trained specialist personnel in accordance with the instructions.
No modifications of any kind may be made to Kentix GmbH products, with the exception of those described in the relevant instructions.
When installing Kentix devices, certain degrees of protection must be guaranteed.
Observe the relevant regulations for installations in the respective environment.
Only operate the products within the defined temperature range.
The instructions should be passed on to the user by the person carrying out the installation.
Kentix accepts no liability for damage to the devices or components caused by incorrect installation. Kentix accepts no liability for incorrectly programmed units.
Kentix accepts no liability for faults, material damage or other damage.
Use of the products, transport and storage
Protect the device from
moisture, dirt and damage during transportation, storage and operation.
Battery powered products
Do not use the products in potentially explosive atmospheres.
Only operate the products within the defined temperature range.
Installation and battery replacement may only be carried out by trained specialist personnel in accordance with the instructions.
Do not charge, short-circuit, open or heat batteries.
Observe the correct polarity when inserting the batteries.
The devices must always be operated with the batteries intended for the product.
When changing the batteries, always replace all batteries.
Dispose of old or used batteries properly.
Keep batteries out of the reach of children.
Maintenance
Kentix devices must be checked for functionality as part of annual maintenance.
Disposal
Electrical appliances and batteries must be disposed of separately from household waste.


System topology

An illustration of the SmartAccess system topology can be found here.

Controls

© Kentix GmbH. This file was automatically generated on 2026-11-04 05:47:31. Please visit docs.kentix.com for the latest documentation.

DoorLock-WA3-V2 Front view

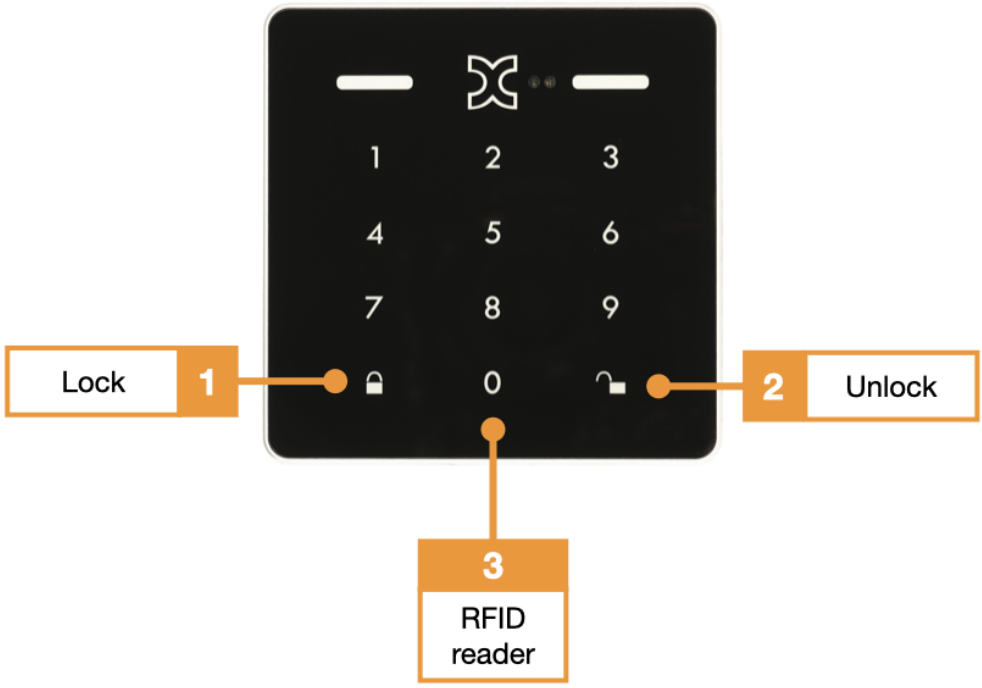


1. Touch keyboard with illuminated keypad and “arm alarm” function key
2. Touch keyboard with illuminated keypad and “disarm alarm” function key
3. Integrated RFID reader, the entire surface serves as a reading surface.

The keypad can be deactivated in the configuration screen of the wall reader (from KentixONE version 8.4.3). This can be useful if an alarm group is only to be armed or disarmed on a specific wall reader using an RFID token.

DoorLock-WA3-V2 Rear view

© Kentix GmbH. This file was automatically generated on 2026-11-04 05:47:31. Please visit docs.kentix.com for the latest documentation.

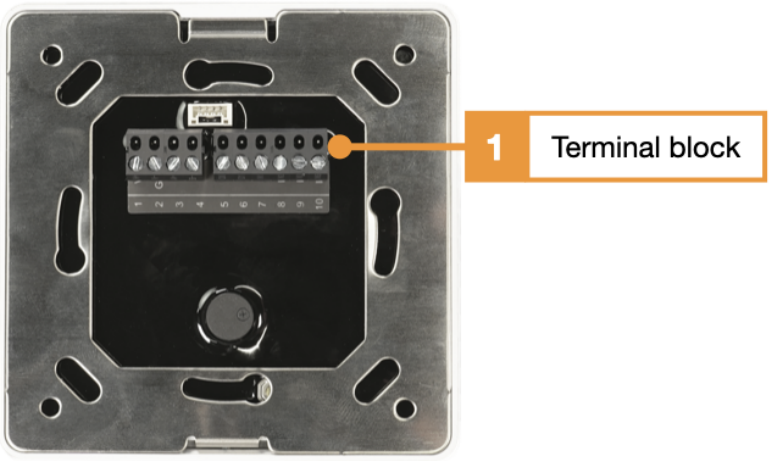

1. Connection terminals, assignment see table

Terminal assignment wall reader WA3-V2

Telecommunication cable type: I-J(ST)Y 2x2x0.^{8mm2} is suitable for connection.

Terminal # Reader	Function Reader	Terminal # AccessManager
1	12-30VDC (+)	3 (+)
2	GND (-)	4 (-)
3	RS-485 A	6 (BUS A)
4	RS-485 B	5 (BUS B)
5	–	–
6	–	–
7	–	–

© Kentix GmbH. This file was automatically generated on 2026-11-04 05:47:31. Please visit docs.kentix.com for the latest documentation.


Terminal # Reader	Function Reader	Terminal # AccessManager
8	–	–
9	–	–
10	–	–

KXC-WA3-IPx-V2 Terminal block

Important! Wall readers of different versions cannot be operated on one AccessManager. The version identifier (e.g. V2) is coded in the article number.

Connection example

Two wall readers with door contacts and external door openers

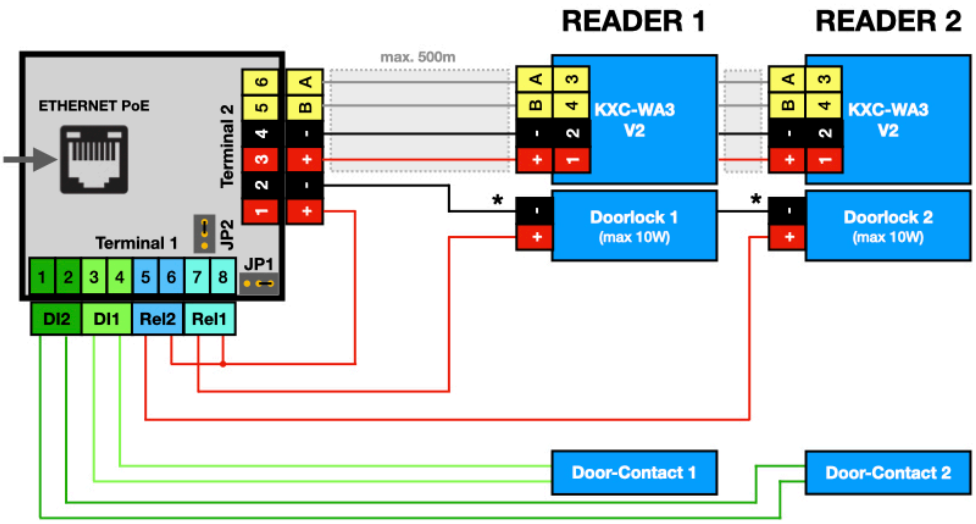

Terminal block 2 on the AccessManager (bus) is used for communication (terminals 5 and 6) and for supplying power (terminals 3 and 4) to the wall readers.

© Kentix GmbH. This file was automatically generated on 2026-11-04 05:47:31. Please visit docs.kentix.com for the latest documentation.

Terminal block 1 on the AccessManager (bus) contains two digital inputs (potential-free) and two relay contacts (changeover contacts). The digital inputs (terminals 1 and 2, terminals 3 and 4) are used to monitor the status of the doors (door contact). The relay contacts (terminals 5 and 6, terminals 7 and 8) can be used to control door openers. A jumper can be used to switch between normally closed and normally open contacts.

Commissioning two wall readers on one AccessManager
If two wall readers are to be operated with one AccessManager, proceed as follows for commissioning:
Connect the first wall reader to the AccessManager. Add it in the main device with “DoorLock (IP)”. Once the first WallReader has been successfully added, disconnect it temporarily from the AccessManager to connect the second WallReader and add it as well. Once both devices have been successfully registered, reconnect the first WallReader to the AccessManager and then put both devices into operation together.

User and access management

The administration of users and access rights is done on the main device of the installation with KentixOne.

All information about the software is available in the KentixONE section.

Signaling

Function	Signal and explanation
Wall reader is offline	LED flashes magenta
Pine input	LED flashes blue
Access granted	short tone, LED flashes green
Door is opened by time profiles	LED lights up permanently green
Access denied	short tone, LED flashes red
Zone is armed	3 long tones, simultaneously LED flashes 3x red
Arming not possible	long tone, LED flashes red
Zone is armed	Kentix logo flashes white

Table signaling

© Kentix GmbH. This file was automatically generated on 2026-11-04 05:47:31. Please visit docs.kentix.com for the latest documentation.